

Test Report No. AFS-R1072

All tests reported herein, have been performed in accordance with the laboratory's scope of accreditation.

Report Date: 16th June 2023

Test Date(s): 08th March 2023

Sample Designer: Neuffer Fenster + Tueren GMBH

Sample Installer: Enveloped Solutions Limited

Test & Sample Details: Performance testing of the Neuffer Idealu 68 Wood/Alu fixed light window unit in accordance with the NZS 4211:2008 Specification for Performance of Windows.

Client Details: Neuffer Fenster + Tueren GMBH
Kronprinzstrasse 8,
70173 Stuttgart,
Germany

Laboratory Details: All Facade Services Limited
47 Bell Road
Beachlands
Auckland 2018

Test Location: 149 Park Road,
Miramar,
Wellington 6022

Tested By: Darryl Scott

KTP / Signatory Darryl Scott

IANZ Accreditation No. 1347

1.Contents

1. Test Summary	3
1.1 Summary Description	3
1.2 Summary Results	3
1.2.1 Air Infiltration	3
1.2.2 Water Penetration	3
1.2.3 Ultimate Strength.....	3
1.3 Overall Compliance	3
2. Test Sample Description	4
3. Testing.....	6
3.1 Test Results	6
4.0 Qualifications.....	7
5.0 References.....	8
6.0 Manufacturers Documentation.....	9

Tested by: 

Darryl Scott /AFS Signatory

Checked by: 

John Moore

1. Test Summary

1.1 Summary Description

The Neuffer Idealu 68 Wood/Alu fixed light window unit comprised of a nominal 2000mm high x 1250mm wide outer box frame which incorporated a clear double glazed IGU, retained by internal glazing beads.

1.2 Summary Results

The following summarises the outcome of the individual tests only. Full test results are recorded at clause 3.1 of this report.

1.2.1 Air Infiltration

The Neuffer Idealu 68 Wood/Alu fixed light window unit complied with the "Air Conditioned" air infiltration rating of NZS 4211:2008 Clause 8 at a differential test pressure of ± 150 Pa.

1.2.2 Water Penetration

The Neuffer Idealu 68 Wood/Alu fixed light window unit complied with the Water Penetration requirement of NZS 4211:2008 Clause 9 for the Very High Wind Zone water penetration test pressure of 375 Pa.

1.2.3 Ultimate Strength

The Neuffer Idealu 68 Wood/Alu fixed light window unit met the Ultimate strength requirements of NZS 4211:2008 Clause 10 for the Very High Wind Zone at ± 1760 Pa.

1.3 Overall Compliance

The Neuffer Idealu 68 Wood/Alu fixed light window unit complied with the requirements of NZS 4211:2008 for the Very High wind zone and an Air Conditioned rating.

These ratings apply to this specific sample and may be used to claim compliance of the range within the stated limitations of clause 5.2 of NZS 4211:2008.

Tested by: 
Darryl Scott /AFS Signatory

Checked by: 
John Moore

2. Test Sample Description

The Neuffer Idealu 68 Wood/Alu fixed light window unit with overall (box size) dimensions of 1996mm high x 1243mm wide, was installed by Enveloped Solutions Limited and Glazing 360 Limited into the timber framed opening of the test booth with the window exterior facing the inside of the booth.

The window comprised of a single fixed light with no transoms, mullions or opening sashes, and was manufactured using the BR-A067-I600 timber frame profile with square cut corners and integrated SS86-20 aluminium cladding profile with mitred corners to the window head and jambs, and the BR-A073-I600 timber frame profile with square cut corners and integrated SS66-19 aluminium cladding profile with mitred corners to the sill.

The fixed light window was clear double glazed with a 24mm thick insulated glazing unit comprising of 2 x 4mm glass panes separated by a 16mm spacer, installed into the glazing platform using 20mm x 35mm glazing beads, an external A31125 glazing gasket and Durasil W15 Plus sealant.

The Durasil W15 Plus sealant was applied as a 3mm x 4mm wet seal to the timber glazing bead/IGU junction and as a bead of unspecified size over top of the A31125 glazing gasket.

The double glazed fixed light window was secured to the surrounding timber framing with manufacturer supplied proprietary fixing brackets screw fixed to the timber window frame and adjacent timber framing at 150 mm from the corners and 450 mm (max) centres thereafter.

Drainage was by way of surface shed only with no integrated drainage pathways.

Details of the Neuffer Idealu 68 Wood/Alu fixed light window unit are shown on the attached Neuffer Fenster drawings numbered 1 - 8.

The drawings identified the following timber profiles, aluminium extrusions and components being used in the construction of the Neuffer Idealu 68 Wood/Alu fixed light window unit.

BR-A067-I600	Timber outer frame – head and jambs
BR-A073-I600	Timber outer frame – sill
SS86-20	Aluminium cladding profile (88mm)
SS66-19	Aluminium cladding profile (68mm)
A31125	EPDM glazing gasket
DC340	Plastic clip
20 x 35mm glazing bead	Timber glazing bead
Sealant	Durasil W15 Plus

Tested by: 
Darryl Scott /AFS Signatory

Checked by: 
John Moore



Photo 1: Interior of the Neuffer fixed light window installed in the test booth.



Photo 2: Exterior of the Neuffer fixed light window installed in the test booth.

Tested by:
Darryl Scott /AFS Signatory

Checked by:
John Moore

3. Testing

The Neuffer Idealu 68 Wood/Alu fixed light window unit was tested in accordance with NZS 4211:2008, Specification for Performance of Windows, with test procedures as detailed in sections of AS/NZS 4420.1:2016.

3.1 Test Results

3.1.1 AIR INFILTRATION (Test Procedure AS/NZS 4420.1 Clause 5)

Overall Window Area	2.48m ²
Opening Joint Length	N/A

Maximum permitted infiltrations/exfiltration's were calculated as follows:

Overall window area x 1.6 - Air Conditioned	3.97 l/s
Overall window area x 8 - Non-Air Conditioned	19.85 l/s

Geometric Mean

Air Conditioned	1.99 l/s
Non-Air Conditioned	4.46 l/s

Air Pressure Direction @ 150PA	Air Flow	Result
Positive Air Infiltration Test Net air flow	1.02 l/s	Complies
Negative Air Infiltration Test Net air flow	0.14 l/s	Complies

The airflow through the sample in the positive direction is (1.02 ± 0.95) l/s. The uncertainty in the airflow through the sample is ± 0.95 l/s. This expanded uncertainty is calculated with a coverage factor, k of 1.98, and defines an interval estimated to have a 95% level of confidence. The standard uncertainty is ± 0.48 l/s, (with 68% probability).

The airflow through the sample in the negative direction is (-0.14 ± 0.94) l/s. The uncertainty in the airflow through the sample is ± 0.94 l/s. This expanded uncertainty is calculated with a coverage factor, k of 1.98, and defines an interval estimated to have a 95% level of confidence. The standard uncertainty is ± 0.48 l/s, (with 68% probability).

The Neuffer Idealu 68 Wood/Alu fixed light window unit complied with the "Air Conditioned" air infiltration rating of NZS 4211:2008 Clause 8 at a differential test pressure of ±150 Pa.

3.1.4 WATER PENETRATION (Test Procedure AS/NZS 4420.1 Clause 6)

Wind Zone	Very High
Maximum rated pressure	375 Pa

The Neuffer Idealu 68 Wood/Alu fixed light window unit complied with the Water Penetration requirement of NZS 4211:2008 Clause 9 for the Very High Wind Zone water penetration test pressure of 375 Pa.

Tested by: 
Darryl Scott /AFS Signatory

Checked by: 
John Moore

3.1.5 ULTIMATE LIMIT STATE STRENGTH (Test Procedure AS/NZS 4420.1 Clause 7)

Wind Zone	Very High
Maximum rated ULS pressure	1760 Pa

The Neuffer Idealu 68 Wood/Alu fixed light window unit met the Ultimate strength requirements of NZS 4211:2008 Clause 10 for the Very High Wind Zone at a differential pressure of ± 1760 Pa.

4.0 Qualifications

4.1 This test report "Test Report No. AFS-R1072" relates solely to NZS 4211:2008 testing carried out on 08th March 2023 on the Neuffer Idealu 68 Wood/Alu fixed light window test sample at the test facility located at 149 Park Road, Miramar, Wellington.

4.2 Drawings of the test specimen as attached to this report have been provided by the client and All Facade Services Ltd accepts no liability with regards the accuracy or entirety of the drawings and/or, in respect of any element missing or concealed from view.

4.3 This report has been prepared solely for the party to whom it is addressed within the terms of the brief provided to this company. This report may not be used in any other context or for any other purpose without our prior written agreement.

4.4 This report may not be read or reproduced other than as a complete document.

4.5 This test report does not constitute endorsement of the window design or the manufacturer in any form.

Tested by: 
Darryl Scott /AFS Signatory

Checked by: 
John Moore


5.0 References

- | | |
|---------------------|-----------------------------------------------------------------------------------------------------------------------|
| NZS 4211:2008 | Specification for performance of windows (Including Amendment 1, May 2014)
Standards New Zealand, Wellington, 2008 |
| NZS 3604:1999 | Timber framed buildings.
Standards New Zealand, Wellington, 1999 |
| AS/NZS 4420.1: 2016 | Windows – Methods of Test |
| Part (a) | Deflection test |
| Part (b) | Operating force test |
| Part (c) | Air infiltration test |
| Part (d) | Water penetration resistance test |
| Part (e) | Ultimate strength test |
| | Standards Australia, Sydney |

Tested by: 
Darryl Scott /AFS Signatory


Checked by: 
John Moore

6.0 Manufacturers Documentation

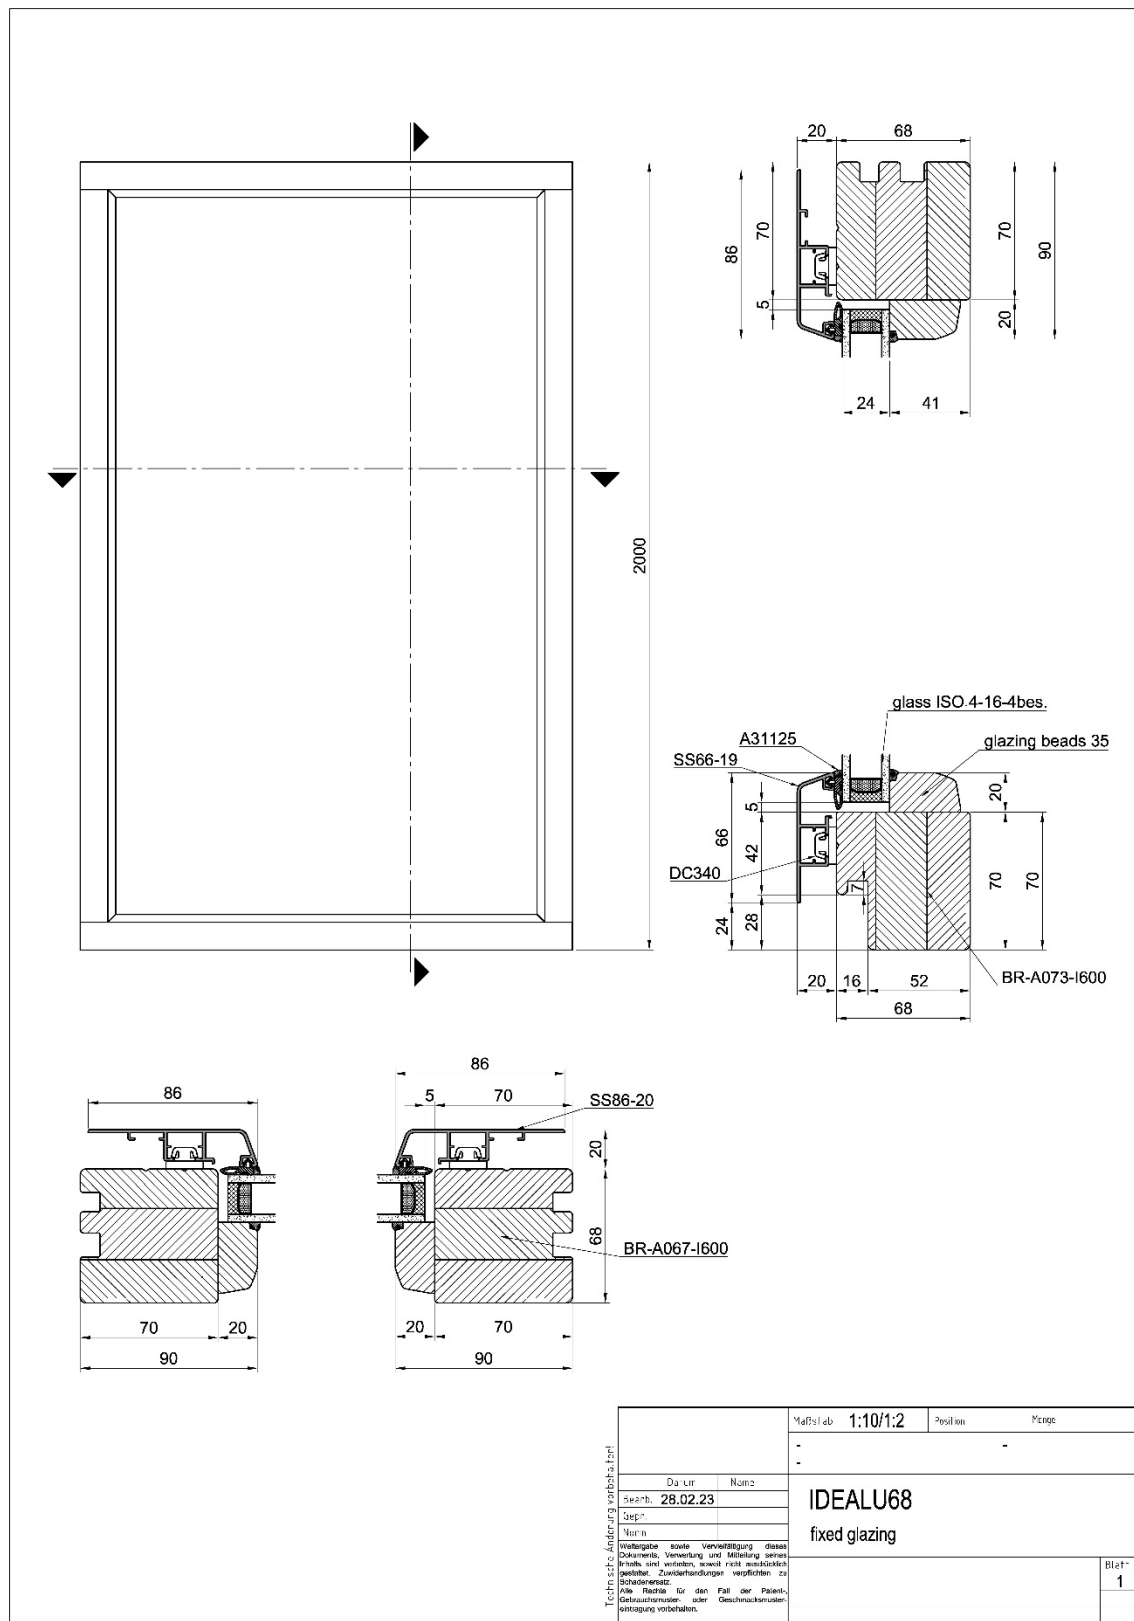

Tested by: 
Darryl Scott /AFS Signatory


Checked by: 
John Moore

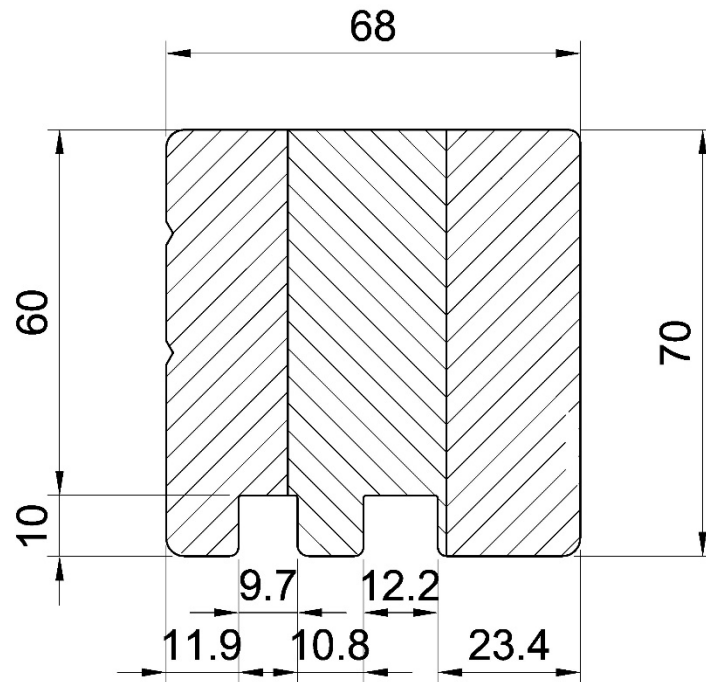

				Oberfläche	Maßstab 1:1	Position	Menge
					-	-	
				Datum	Name	IDEALU68 fixed glazing frame BR-A067-I600	
				Bearb. 28.02.23			
				Gepr.			
				Norm			
				Weitergabe sowie Vervielfältigung dieses Dokuments, Verwertung und Mitteilung seines Inhalts sind verboten, soweit nicht ausdrücklich gestattet. Zuwiderhandlungen verpflichten zu Schadenersatz. Alle Rechte für den Fall der Patent-, Gebrauchsmuster- oder Geschmacksmustereintragung vorbehalten.			
Zust.	Änderungen	Datum	Name	Blatt 1			

Tested by:
Darryl Scott /AFS Signatory


Checked by:
John Moore

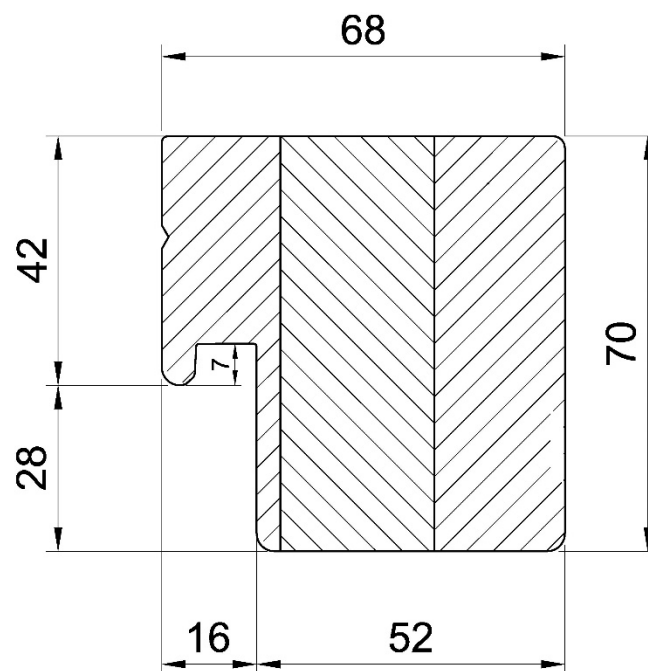

		Oberfläche		Maßstab 1:1	Position	Menge
				-	-	-
				IDEALU68 fixed glazing frame BR-A073-I600		
				Weitergabe sowie Vervielfältigung dieses Dokuments, Verwertung und Mitteilung seines Inhalts sind verboten, soweit nicht ausdrücklich gestattet. Zuwiderhandlungen verpflichten zu Schadenersatz. Alle Rechte für den Fall der Patent-, Gebrauchsmuster- oder Geschmacksmustereintragung vorbehalten.		
				Blatt 2		
Zust.		Änderungen		Datum		Name


Tested by:
 Darryl Scott /AFS Signatory

Checked by:
 John Moore



Darryl Scott /AFS Signatory


John Moore

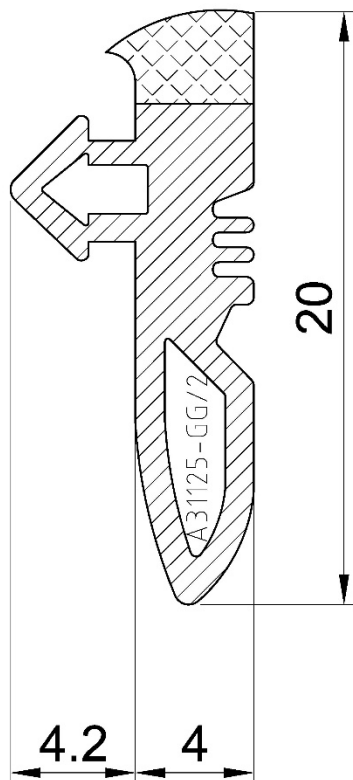

				Oberfläche	Maßstab 5:1	Position	Menge
					-	-	-
				Datum	Name		
				Bearb. 28.02.23			
				Gepr.			
				Norm			
				Weitergabe sowie Vervielfältigung dieses Dokuments, Verwertung und Mitteilung seines Inhalts sind verboten, soweit nicht ausdrücklich gestattet. Zuwiderhandlungen verpflichten zu Schadenersatz. Alle Rechte für den Fall der Patent-, Gebrauchsmuster- oder Geschmacksmustereintragung vorbehalten.			
				IDEALU68 gasket A31125			
				Blatt 4			
Zust.	Änderungen	Datum	Name				

Tested by:
Darryl Scott /AFS Signatory

Checked by:
John Moore

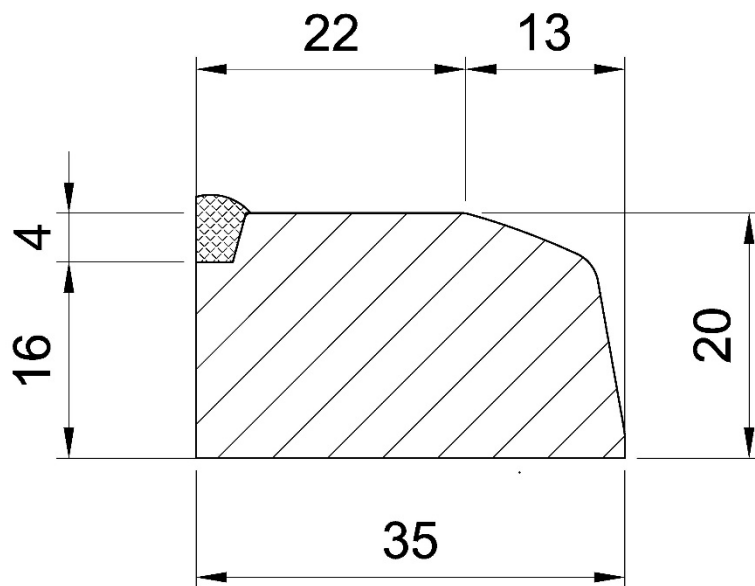


				Oberfläche	Maßstab 2:1	Position	Menge
					-	-	
				Datum	Name		
				Bearb.	25.07.18		
				Gepr.			
				Norm			
				Weitergabe sowie Vervielfältigung dieses Dokuments, Verwertung und Mitteilung seines Inhalts sind verboten, soweit nicht ausdrücklich gestattet. Zuwiderhandlungen verpflichten zu Schadenersatz.			
				Alle Rechte für den Fall der Patent-, Gebrauchsmuster- oder Geschmacksmustereintragung vorbehalten.			
				IDEALU68 NET			
				glazing beads profiliert 35 211			
				Blatt 5			
Zust.	Änderungen	Datum	Name				

Technische Änderung vorbehalten!

Tested by:
Darryl Scott /AFS Signatory

Checked by:
John Moore

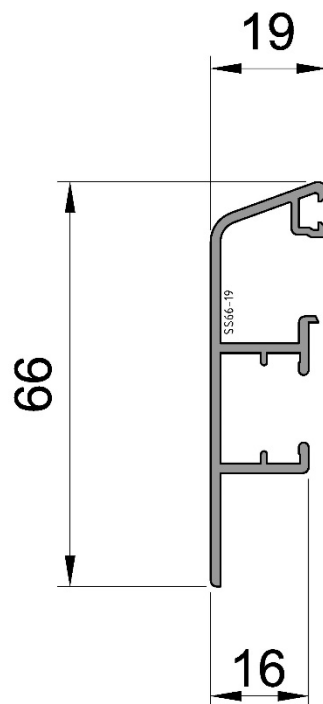

				Oberfläche	Maßstab 1:1	Position	Menge
					-	-	-
				Datum	Name	IDEALU68 fixed glazing cladding profile SS66-19	
				Bearb.	28.02.23		
				Gepr.			
				Norm			
				<small>Weitergabe sowie Vervielfältigung dieses Dokuments, Verwertung und Mitteilung seines Inhalts sind verboten, soweit nicht ausdrücklich gestattet. Zuwiderhandlungen verpflichten zu Schadenersatz. Alle Rechte für den Fall der Patent-, Gebrauchsmuster- oder Geschmacksmuster-eintragung vorbehalten.</small>			
Zust.	Änderungen	Datum	Name	Blatt 6			

Tested by:
 Darryl Scott /AFS Signatory

Checked by:
 John Moore

				Oberfläche		Maßstab	1:1	Position	Menge
						-	-	-	
Technische Änderung vorbehalten! Zust. Änderungen Datum Name				Datum	Name	IDEALU68 fixed glazing cladding profile SS86-20			
				Bearb.	28.02.23				
				Gepr.					
				Norm				Blatt	
				Weitergabe sowie Vervielfältigung dieses Dokuments, Verwertung und Mitteilung seines Inhalts sind verboten, soweit nicht ausdrücklich gestattet. Zuwiderhandlungen verpflichten zu Schadenersatz. Alle Rechte für den Fall der Patent-, Gebrauchsmuster- oder Geschmacksmuster- eintragung vorbehalten.			7		

Tested by:
 Darryl Scott /AFS Signatory

Checked by:
 John Moore

		Oberfläche		Maßstab 1:1	Position	Menge
				-	-	-
		Datum		IDEALU68 fixed glazing DC340		
		Name				
		Bearb. 28.02.23				
		Gepr.				
		Norm		Weitergabe sowie Vervielfältigung dieses Dokuments, Verwertung und Mitteilung seines Inhalts sind verboten, soweit nicht ausdrücklich gestattet. Zuwiderhandlungen verpflichten zu Schadenersatz. Alle Rechte für den Fall der Patent-, Gebrauchsmuster- oder Geschmacksmuster-eintragung vorbehalten.		
Zust.	Änderungen	Datum	Name	Blatt 8		

Tested by:
 Darryl Scott /AFS Signatory

Checked by:
 John Moore