

Test Report No. AFS-R1077

All tests reported herein, have been performed in accordance with the laboratory's scope of accreditation.

Report Date: 15th June 2023

Test Date(s): 13th March 2023

Sample Designer: Neuffer Fenster + Tueren GMBH

Sample Installer: Glazing 360 Limited

Test & Sample Details: Performance testing of the Neuffer Idealu 68 Wood/Alu Tilt & Turn Sash Window unit in accordance with the NZS 4211:2008 Specification for Performance of Windows.

Client Details: Neuffer Fenster + Tueren GMBH
Kronprinzstrasse 8,
70173 Stuttgart,
Germany

Laboratory Details: All Facade Services Limited
47 Bell Road
Beachlands
Auckland 2018

Test Location: 149 Park Road,
Miramar,
Wellington 6022

Tested By: Darryl Scott

KTP / Signatory Darryl Scott

IANZ Accreditation No. 1347

1.Contents

1. Test Summary	3
1.1 Summary Description	3
1.2 Summary Results	3
1.2.1 Deflection of Structural Members	3
1.2.2 Air Infiltration	3
1.2.3 Water Penetration	3
1.2.4 Ultimate Strength.....	3
1.2.5 Torsional Strength	3
1.3 Overall Compliance	3
2. Test Sample Description	4
3. Testing.....	6
3.1 Test Results	6
4.0 Qualifications	8
5.0 References.....	9
6.0 Manufacturers Documentation.....	10

Tested by: 
Darryl Scott / AFS Signatory

Checked by: 
John Moore

1. Test Summary

1.1 Summary Description

The Neuffer Idealu 68 Wood/Alu Open In Tilt & Turn Sash Window unit comprised of a nominal 1600mm high x 1100mm wide outer box frame which incorporated a clear double glazed IGU, retained by external glazing beads.

1.2 Summary Results

The following summarises the outcome of the individual tests only. Full test results are recorded at clause 3.1 of this report.

1.2.1 Deflection of Structural Members

The FL A089-1x68-80 timber lock stile of the Neuffer Idealu 68 Wood/Alu Tilt & Turn Sash Window unit, when tested with a differential test booth pressure of +1515 Pa, complied with Serviceability span/200 deflection requirements of NZS 4211:2008 Clause 6, for an Extra High wind zone.

1.2.2 Air Infiltration

The Neuffer Idealu 68 Wood/Alu Tilt & Turn Sash Window unit complied with the "Air Conditioned" air infiltration rating of NZS 4211:2008 Clause 8 at a differential test pressure of ± 150 Pa.

1.2.3 Water Penetration

The Neuffer Idealu 68 Wood/Alu Tilt & Turn Sash Window unit complied with the Water Penetration requirement of NZS 4211:2008 Clause 9 for the Extra High Wind Zone water penetration test pressure of 455 Pa.

Following testing at 455 Pa, the Neuffer Idealu 68 Wood/Alu Tilt & Turn Sash Window unit was tested and complied with the Water Penetration requirement of NZS 4211:2008 Clause 9 at the increased differential pressures of 533 Pa and 1000 Pa.

1.2.4 Ultimate Strength

The Neuffer Idealu 68 Wood/Alu Tilt & Turn Sash Window unit met the Ultimate strength requirements of NZS 4211:2008 Clause 10 for the Extra High Wind Zone at ± 2130 Pa.

1.2.5 Torsional Strength

The Neuffer Idealu 68 Wood/Alu Tilt & Turn Sash Window unit, as supplied, and when double glazed with a 24mm IGU and tested in accordance with NZS 4211:2008 Appendix A, complied with the performance requirements of NZS 4211 Clause 11.

1.3 Overall Compliance

The Neuffer Idealu 68 Wood/Alu Tilt & Turn Sash Window unit, when double glazed with a 24mm IGU, complied with the requirements of NZS 4211:2008 for the Extra High wind zone and an Air Conditioned rating.

These ratings apply to this specific sample and may be used to claim compliance of the range within the stated limitations of clause 5.2 of NZS 4211:2008.

Tested by: 
Darryl Scott / AFS Signatory

Checked by: 
John Moore

2. Test Sample Description

The Neuffer Idealu 68 Wood/Alu open in Tilt & Turn Sash Window unit with overall (box size) dimensions of 1573mm high x 1093mm wide, was installed by Glazing 360 Limited into the timber framed opening of the test booth with the window exterior facing the inside of the booth.

The open in Tilt & Turn Sash Window unit comprised of an open in hinged window sash and was manufactured using the BR-A067-I602 timber frame profile with square cut corners and integrated SS68-20 aluminium cladding profile with mitred corners to the perimeter frame head and jambs, and the BR-A073-I602 timber frame profile with square cut corners and integrated SS66-19 aluminium cladding profiles with mitred corners to the sill.

The open in window sash panel was configured as both a hinged and tilting window.

The Tilt & Turn window sash panel was manufactured using the FL-A089-Ix68-080 timber sash profile with square cut corners and FL40-20 aluminium cladding profile with mitred corners.

The Tilt & Turn Sash Window was clear double glazed with a 24mm thick, argon filled, insulated glazing unit comprising of 2 x 4mm glass panes separated by a 16mm spacer, installed into the glazing platform using external the FL40-20 aluminium cladding profile, an external AA3198 glazing gasket and Durasil W15 Plus sealant.

The Durasil W15 Plus sealant was applied as a wet seal of unspecified size to the interior junction of the IGU with the timber sash.

The double glazed Tilt & Turn Sash Window was secured to the surrounding timber framing with manufacturer supplied proprietary fixing brackets, screw fixed to the timber window frame and adjacent timber framing at 150 mm from the corners and 450 mm (max) centres thereafter.

Drainage was by way of surface shed only with no integrated drainage pathways.

Details of the Neuffer Idealu 68 Wood/Alu Tilt & Turn Sash Window unit are shown on the attached Neuffer Fenster drawings numbered 1 - 15.

The drawings identified the following timber profiles, aluminium extrusions and components being used in the construction of the Neuffer Idealu 68 Wood/Alu Tilt & Turn Sash Window unit.

BR-A067-I602	Outer frame – head and jambs
BR-A073-I602	Outer frame – sill
FL-A089-IxEP-080	Timber sash profile
SS86-20	Aluminium cladding profile (86mm)
SS66-19	Aluminium cladding profile (66mm)
FL40-20	Aluminium cladding profile
FF2048/GG/2	EPDM sealing gasket
AFK2613/GG/2	EPDM sealing gasket
MFK2037/GG/2	EPDM sealing gasket
31123-GG	EPDM sealing gasket
AA31-98-GG/2	EPDM glazing gasket
DC340	Plastic clip
MEH40	Plastic clip
Secustic	Window handle
Sealant	Durasil W15 Plus

Tested by: 
Darryl Scott / AFS Signatory

Checked by: 
John Moore



*Photo 1: Interior of the Neuffer Idealu 68 Wood/Alu
Tilt & Turn Sash Window installed in the test booth.*

Tested by:
Darryl Scott / AFS Signatory

Checked by:
John Moore

3. Testing

The Neuffer Idealu 68 Wood/Alu Open In Tilt & Turn Sash Window unit was tested in accordance with NZS 4211:2008, Specification for Performance of Windows, with test procedures as detailed in sections of AS/NZS 4420.1:2016.

3.1 Test Results

3.1.1 SERVICEABILITY DEFLECTION (Test Procedure AS/NZS 4420.1 Clause 3)

Deflection measurements were made on the FL-A089-lxEP-080 timber lock stile with compliance assessments made against the tabled Serviceability Wind Pressures at a deflection ratio of span/200

FL-A089-lxEP-080 Lock Stile

Overall height	1573 mm
Test Span	1492 mm
Maximum permitted deflection span/200)	7.46 mm

Positive Pressure Test

Positive Pressure Test	Net Deflection	Result
Deflection at 303 Pa	0.27 mm	Complies
Deflection at 606 Pa	0.59 mm	Complies
Deflection at 909 Pa	0.90 mm	Complies
Deflection at 1212 Pa	1.18 mm	Complies
Deflection at 1515 Pa	1.35 mm	Complies

The FL A089-lx68-80 timber lock stile of the Neuffer Idealu 68 Wood/Alu Tilt & Turn Sash Window unit, when tested with a differential test booth pressure of +1515 Pa, complied with Serviceability span/200 deflection requirements of NZS 4211:2008 Clause 6, for an Extra High wind zone.

Note: As the FL-A089-lxEP-080 Lock Stile closed against the fixed jamb of the Neuffer Idealu 68 Wood/Alu Open In Tilt & Turn Sash Window, structural deflection testing was required in the positive pressure orientation only. The location of the deflection transducers on the FL A089-lx68-80 lock stile is shown at Photo 1.

3.1.2 AIR INFILTRATION (Test Procedure AS/NZS 4420.1 Clause 5)

Overall Window Area	1.719m ²
Opening Joint Length	4.770m

Maximum permitted infiltrations/exfiltration's were calculated as follows:

Overall window area x 1.6 - Air Conditioned	2.75 l/s
Overall window area x 8 - Non-Air Conditioned	13.75 l/s
Opening joint length x 0.6 - Air Conditioned	2.86 l/s
Opening joint x 2 - Non-Air Conditioned	9.54 l/s

Geometric Mean

Air Conditioned	2.81 l/s
Non-Air Conditioned	11.5 l/s

Tested by: 
Darryl Scott / AFS Signatory

Checked by: 
John Moore

Air Pressure Direction @ 150PA	Air Flow	Result
Positive Air Infiltration Test Net air flow	0.19 l/s	Complies
Negative Air Infiltration Test Net air flow	0.51 l/s	Complies

The airflow through the sample in the positive direction is (0.19 ± 0.4) l/s. The uncertainty in the airflow through the sample is ± 0.4 l/s. This expanded uncertainty is calculated with a coverage factor, k of 2.01, and defines an interval estimated to have a 95% level of confidence. The standard uncertainty is ± 0.2 l/s, (with 68% probability).

The airflow through the sample in the negative direction is (-0.51 ± 0.5) l/s. The uncertainty in the airflow through the sample is ± 0.5 l/s. This expanded uncertainty is calculated with a coverage factor, k of 2.13, and defines an interval estimated to have a 95% level of confidence. The standard uncertainty is ± 0.23 l/s, (with 68% probability).

The Neuffer Idealu 68 Wood/Alu Tilt & Turn Sash Window unit complied with the "Air Conditioned" air infiltration rating of NZS 4211:2008 Clause 8 at a differential test pressure of ± 150 Pa.

3.1.3 WATER PENETRATION (Test Procedure AS/NZS 4420.1 Clause 6)

Wind Zone	Extra High
Maximum rated pressure	455 Pa

The Neuffer Idealu 68 Wood/Alu Tilt & Turn Sash Window unit complied with the Water Penetration requirement of NZS 4211:2008 Clause 9 for the Extra High Wind Zone water penetration test pressure of 455 Pa.

Following testing at 455 Pa, the Neuffer Idealu 68 Wood/Alu Tilt & Turn Sash Window unit was tested and complied with the Water Penetration requirement of NZS 4211:2008 Clause 9 at the increased differential pressures of 533 Pa and 1000 Pa.

3.1.4 ULTIMATE LIMIT STATE STRENGTH (Test Procedure AS/NZS 4420.1 Clause 7)

Wind Zone	Extra High
Maximum rated ULS pressure	2130 Pa

The Neuffer Idealu 68 Wood/Alu Tilt & Turn Sash Window unit met the Ultimate strength requirements of NZS 4211:2008 Clause 10 for the Extra High Wind Zone at a differential pressure of ± 2130 Pa.

3.1.5 TORSIONAL STRENGTH OF SASHES (NZS 4211:2008 Clause 11)

Tilting Hinged Sash

Length of shortest sash member (mm)	956 mm
Calculated maximum allowed deflection = $0.04 \times$ shortest sash member (mm).	37.0 mm

Tested by: 
Darryl Scott / AFS Signatory

Checked by: 
John Moore

Table 19. NZS 4211 Appendix A Torsional strength of sashes measurements

Force (N)	Direction	Displacement (mm)	Result
10	Opening	0.95 mm	Complies
20	Opening	2.14 mm	Complies
30	Opening	3.50 mm	Complies
40	Opening	4.71 mm	Complies
10	Closing	0.97 mm	Complies
20	Closing	2.23 mm	Complies
30	Closing	3.48 mm	Complies
40	Closing	4.64 mm	Complies

The Neuffer Idealu 68 Wood/Alu Tilt & Turn Sash Window unit, as supplied, and when double glazed with a 24mm IGU and tested in accordance with NZS 4211:2008 Appendix A, complied with the performance requirements of NZS 4211 Clause 11.

4.0 Qualifications

4.1 This test report "Test Report No. AFS-R1077" relates solely to NZS 4211:2008 testing carried out on the 13th of March 2023 on the Neuffer Idealu 68 Wood/Alu Tilt & Turn Sash Window test sample, at the test facility located at 149 Park Road, Miramar, Wellington.

4.2 Drawings of the test specimen as attached to this report have been provided by the client and All Facade Services Ltd accepts no liability with regards the accuracy or entirety of the drawings and/or, in respect of any element missing or concealed from view.

4.3 This report has been prepared solely for the party to whom it is addressed within the terms of the brief provided to this company. This report may not be used in any other context or for any other purpose without our prior written agreement.

4.4 This report may not be read or reproduced other than as a complete document.

4.5 This test report does not constitute endorsement of the window design or the manufacturer in any form.

Tested by: 
Darryl Scott / AFS Signatory


Checked by: 
John Moore

5.0 References

NZS 4211:2008	Specification for performance of windows (Including Amendment 1, May 2014) Standards New Zealand, Wellington, 2008
NZS 3604:1999	Timber framed buildings. Standards New Zealand, Wellington, 1999
AS/NZS 4420.1: 2016	Windows – Methods of Test
Part (a)	Deflection test
Part (b)	Operating force test
Part (c)	Air infiltration test
Part (d)	Water penetration resistance test
Part (e)	Ultimate strength test
	Standards Australia, Sydney

Tested by: 
Darryl Scott / AFS Signatory


Checked by: 
John Moore

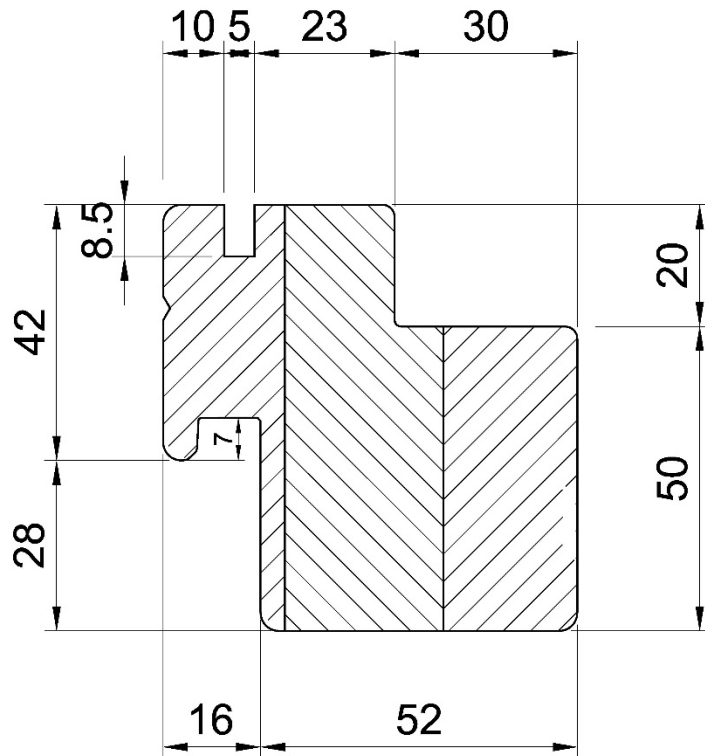

				Oberfläche	Maßstab 1:1	Position	Menge
					-		-
				Datum	Name	IDEALU68 frame BR-A073-I602	
				Bearb.	28.02.23		
				Gepr.			
				Norm			
				Weitergabe sowie Vervielfältigung dieses Dokuments, Verwertung und Mitteilung seines Inhalts sind verboten, soweit nicht ausdrücklich gestattet. Zuwiderhandlungen verpflichten zu Schadenersatz. Alle Rechte für den Fall der Patent-, Gebrauchsmuster- oder Geschmacksmustereintragung vorbehalten.			
Zust.	Änderungen	Datum	Name	Blatt 1			

Tested by:
Darryl Scott / AFS Signatory

Checked by:
John Moore

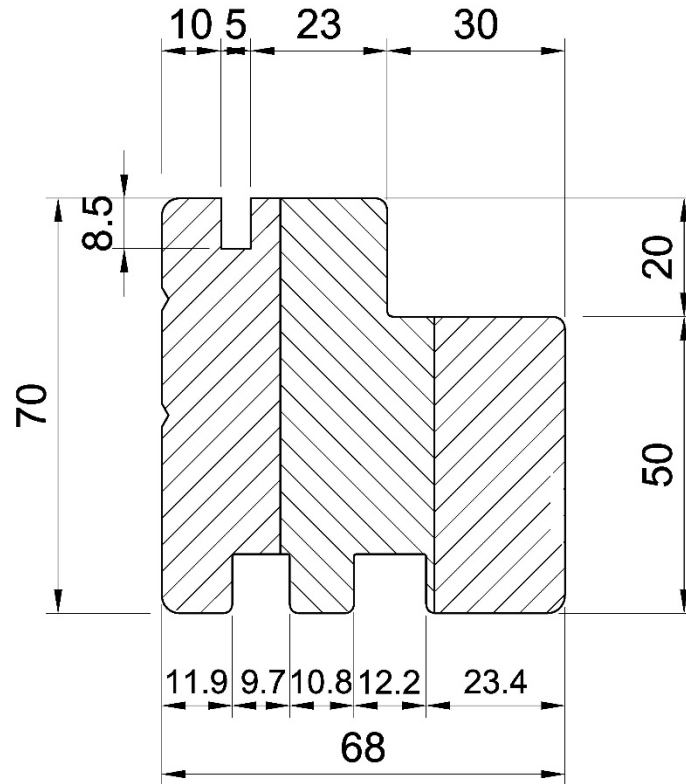


Technische Änderung vorbehalten!

				Oberfläche	Maßstab 1:1	Position	Menge
					-	-	-
			Datum	Name	IDEALU68 frame BR-A067-I602 D9010		
			Bearb. 28.02.23				
			Gepr.				
			Norm				
				Weitergabe sowie Vervielfältigung dieses Dokuments, Verwertung und Mitteilung seines Inhalts sind verboten, soweit nicht ausdrücklich gestattet. Zuwiderhandlungen verpflichten zu Schadenersatz. Alle Rechte für den Fall der Patent-, Gebrauchsmuster- oder Geschmacksmustereintragung vorbehalten.			Blatt 2
Zust.	Änderungen	Datum	Name				

Tested by: 
Darryl Scott / AFS Signatory

Checked by: 
John Moore

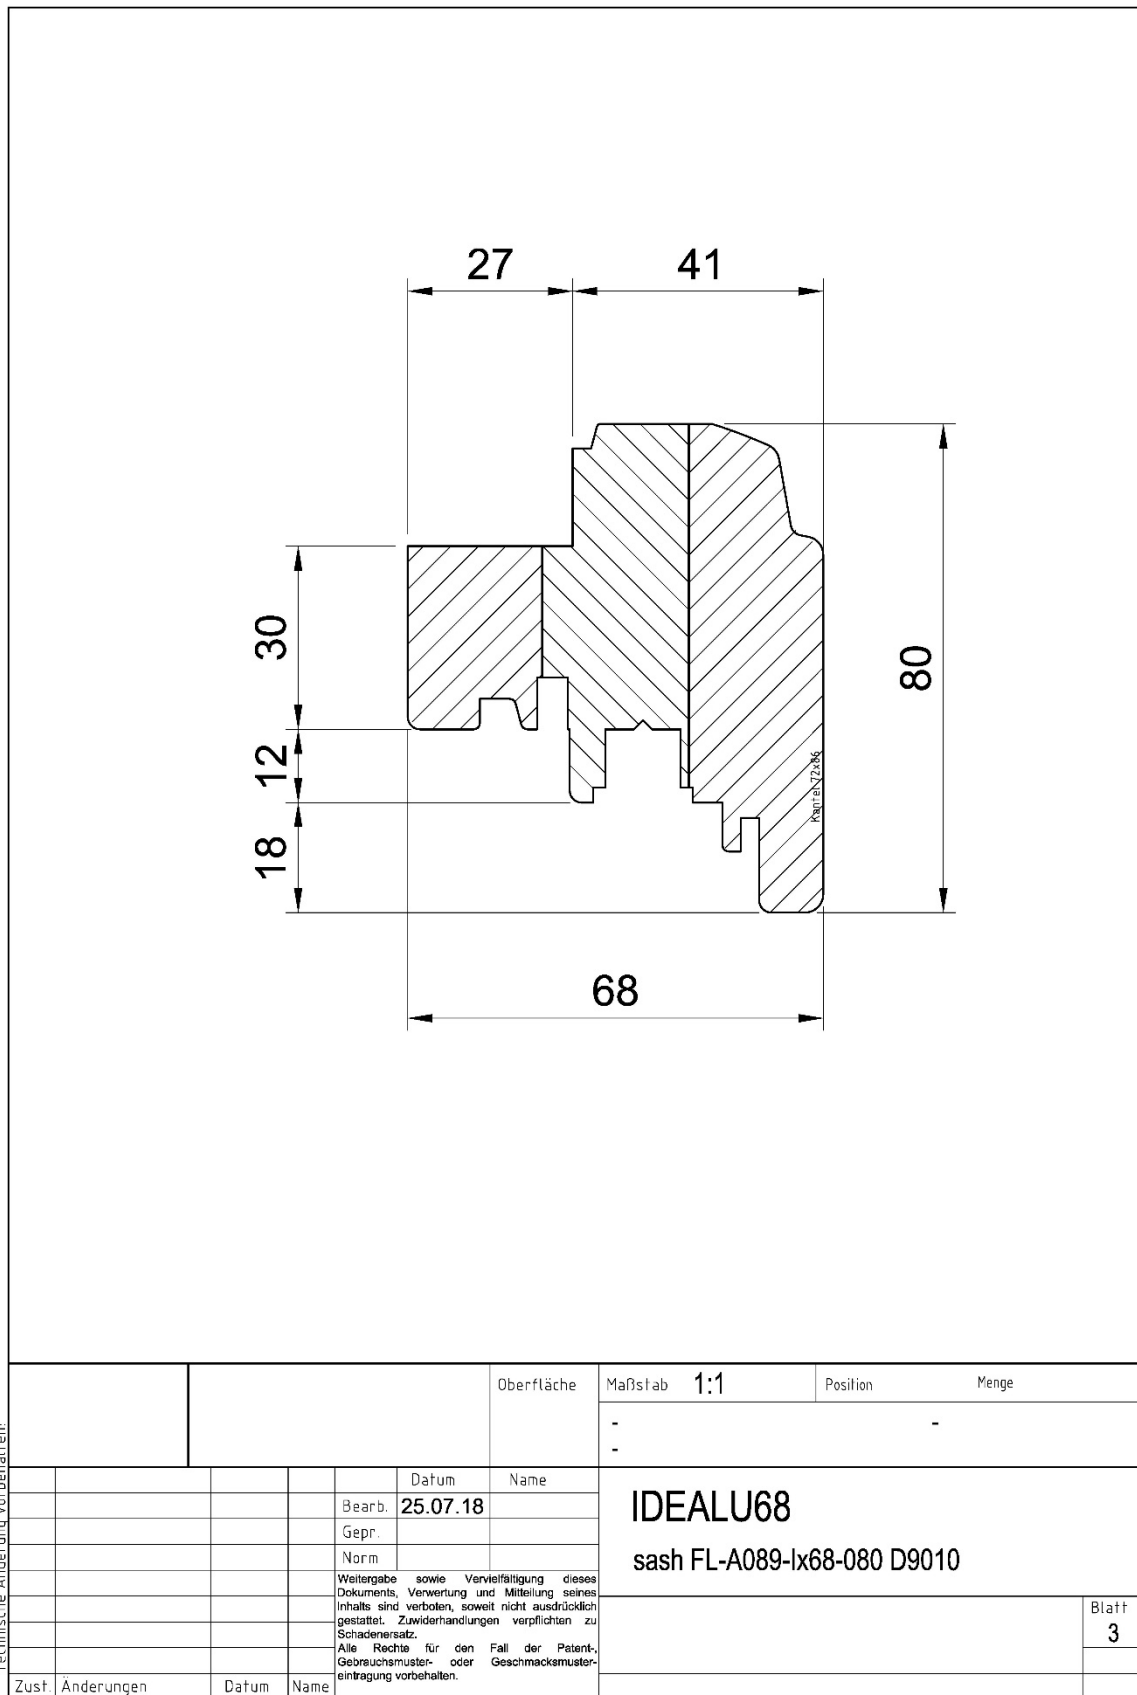

Tested by:
Darryl Scott / AFS Signatory


Checked by:
John Moore



Darryl Scott / AFS Signatory

John Moore

Checked by: JK Moore
John Moore

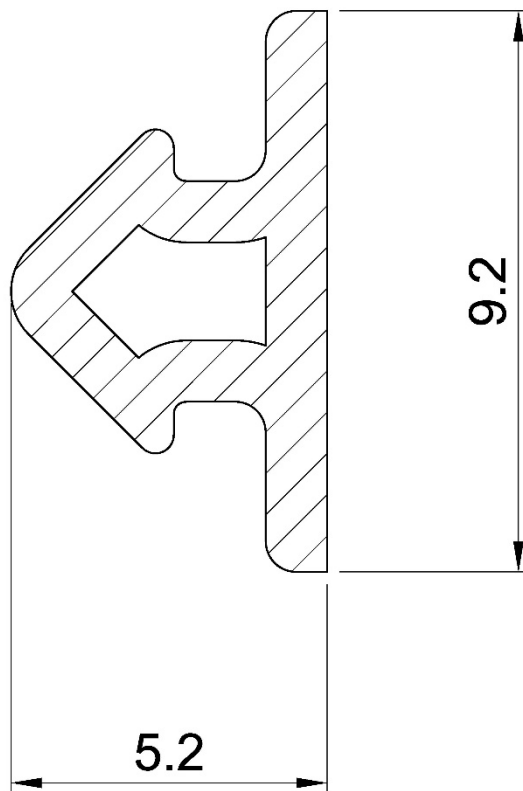


Technische Änderung vorbehalten!

				Oberfläche	Maßstab 10:1	Position	Menge
					-	-	-
				Datum	Name	IDEALU68 gasket FF2048/GG/2	
				Bearb. 28.02.23			
				Gepr.			
				Norm			
<small>Weitergabe sowie Vervielfältigung dieses Dokuments, Verwertung und Mitteilung seines Inhalts sind verboten, soweit nicht ausdrücklich gestattet. Zuwiderhandlungen verpflichten zu Schadenersatz. Alle Rechte für den Fall der Patent-, Gebrauchsmuster- oder Geschmacksmustereintragung vorbehalten.</small>						Blatt	6
Zust	Änderungen	Datum	Name				

Tested by:
Darryl Scott / AFS Signatory


Checked by:
John Moore

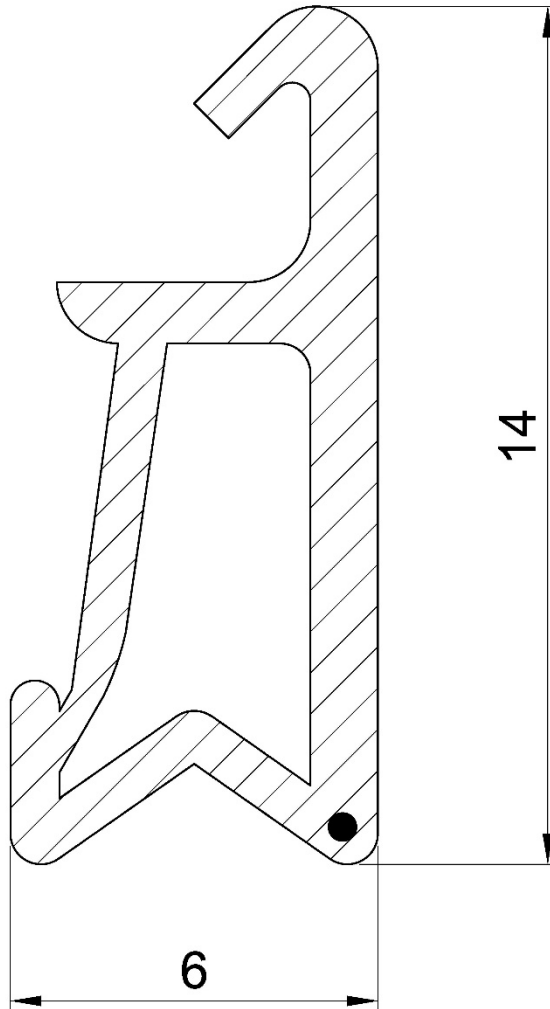

				Oberfläche	Maßstab 10:1	Position	Menge
					-	-	
				Datum	Name		
				Bearb.	28.02.23		
				Gepr.			
				Norm			
				Weitergabe sowie Vervielfältigung dieses Dokuments, Verwertung und Mitteilung seines Inhalts sind verboten, soweit nicht ausdrücklich gestattet. Zuwiderhandlungen verpflichten zu Schadenersatz.			
				Alle Rechte für den Fall der Patent-, Gebrauchsmuster- oder Geschmacksmustereintragung vorbehalten.			
				IDEALU68 gasket AFK2613-GG/2			
				Blatt 7			
Zust.	Änderungen	Datum	Name				

Tested by:
Darryl Scott / AFS Signatory

Checked by:
John Moore

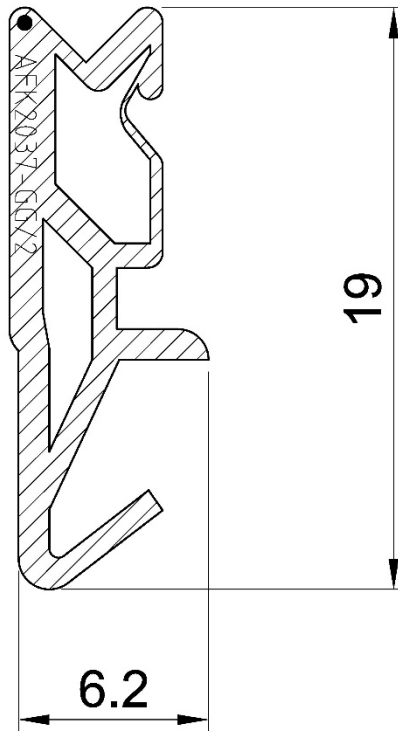

				Oberfläche	Maßstab 5:1	Position	Menge
					-	-	-
				Datum	Name	IDEALU68 gasket MFK2037-GG/2	
				Bearb. 28.02.23			
				Gepr.			
				Norm			
				<small>Weitergabe sowie Vervielfältigung dieses Dokuments, Verwertung und Mitteilung seines Inhalts sind verboten, soweit nicht ausdrücklich gestattet. Zuwiderhandlungen verpflichten zu Schadenersatz. Alle Rechte für den Fall der Patent-, Gebrauchsmuster- oder Geschmacksmustereintragung vorbehalten.</small>			
Zust.	Änderungen	Datum	Name	Blatt 8			


Tested by:
Darryl Scott / AFS Signatory

Checked by:
John Moore

		Oberfläche		Maßstab	5:1	Position	Menge
				-	-	-	-
Technische Änderung vorbehalten! Zust. Änderungen Datum Name		Bearb.	28.02.23	IDEALU68 gasket 31123-GG			
		Gepr.					
		Norm					
		Weitergabe sowie Vervielfältigung dieses Dokuments, Verwertung und Mitteilung seines Inhalts sind verboten, soweit nicht ausdrücklich gestattet. Zuwiderhandlungen verpflichten zu Schadenersatz. Alle Rechte für den Fall der Patent-, Gebrauchsmuster- oder Geschmacksmustereintragung vorbehalten.				Blatt	9

Tested by:
Darryl Scott / AFS Signatory


Checked by:
John Moore

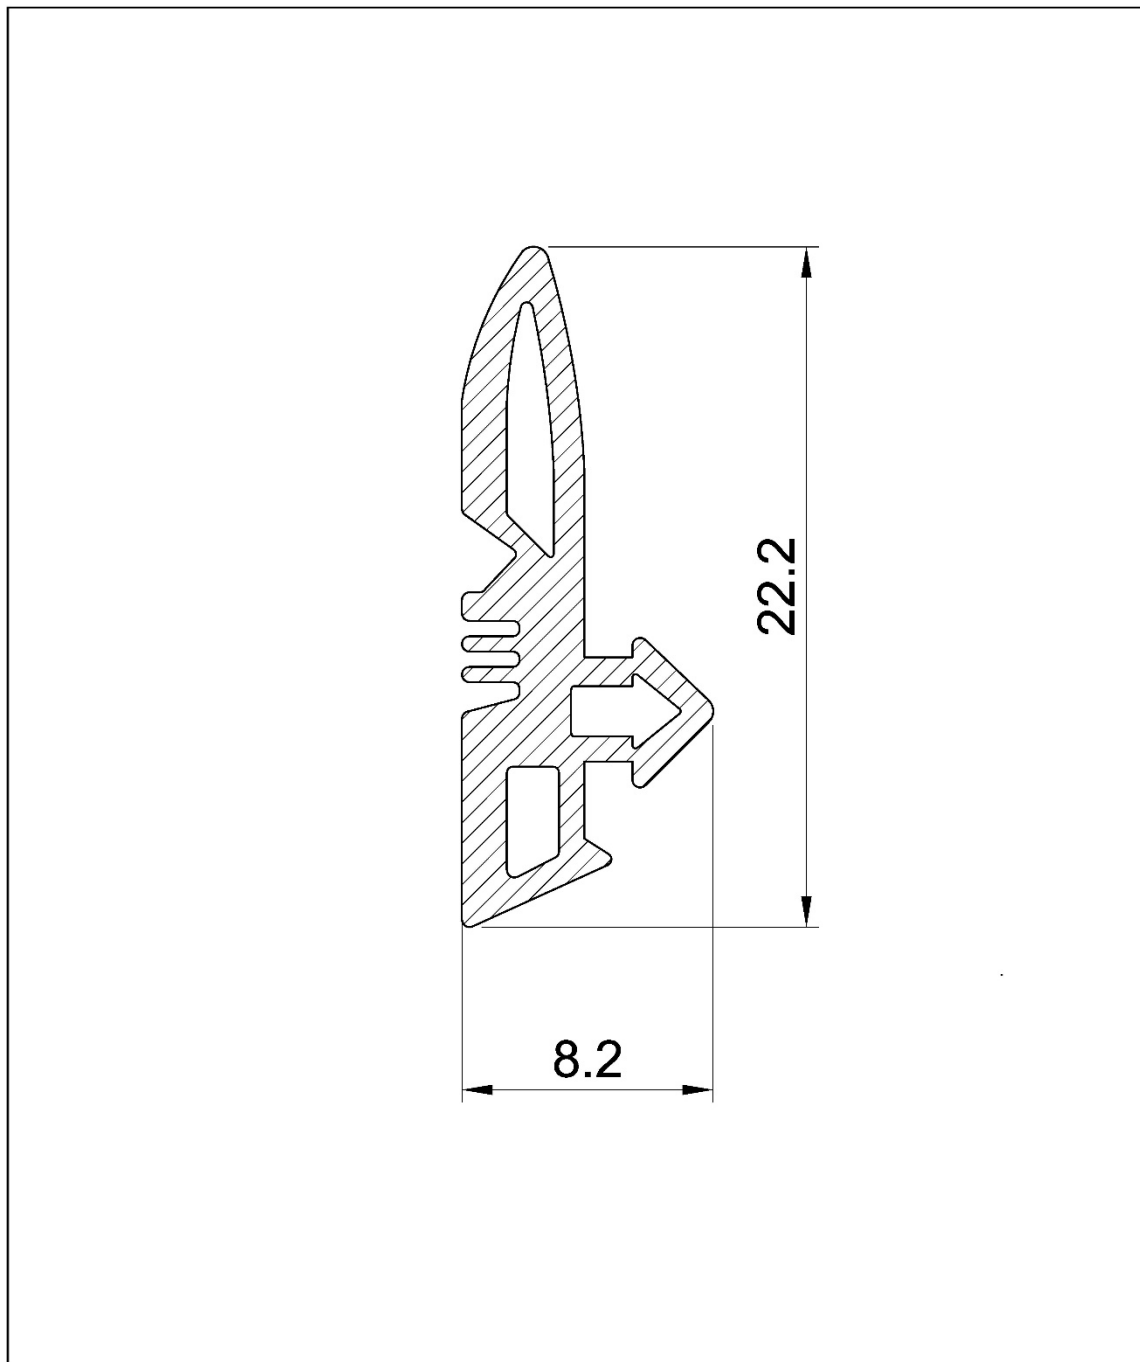

				Oberfläche		Maßstab 5:1	Position	Menge
						-	-	-
				Datum	Name	IDEALU68 gasket AA31-98-GG/2		
				Bearb.	28.02.23			
				Gepr.				
				Norm				
				Weitergabe sowie Vervielfältigung dieses Dokuments, Verwertung und Mitteilung seines Inhalts sind verboten, soweit nicht ausdrücklich gestattet. Zuwiderhandlungen verpflichten zu Schadensersatz. Alle Rechte für den Fall der Patent-, Gebrauchsmuster- oder Geschmacksmustereintragung vorbehalten.				
Zust.	Änderungen	Datum	Name	Blatt 10				

Tested by:
Darryl Scott / AFS Signatory


Checked by:
John Moore

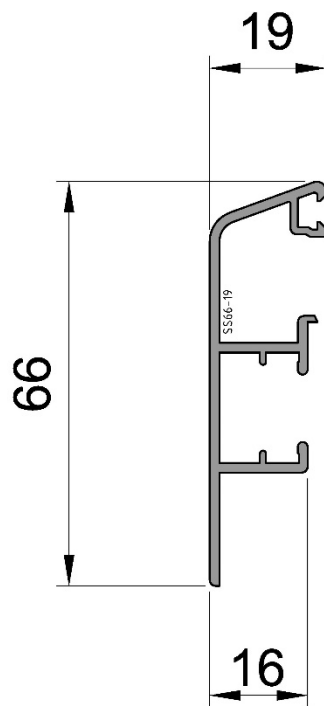

				Oberfläche	Maßstab 1:1	Position	Menge
					-	-	-
				Datum	Name	IDEALU68 cladding profile SS66-19	
				Bearb. 28.02.23			
				Gepr.			
				Norm			
				Weitergabe sowie Vervielfältigung dieses Dokuments, Verwertung und Mitteilung seines Inhalts sind verboten, soweit nicht ausdrücklich gestattet. Zuwiderhandlungen verpflichten zu Schadenersatz. Alle Rechte für den Fall der Patent-, Gebrauchsmuster- oder Geschmacksmustereintragung vorbehalten.			Blatt 11
Zust.	Änderungen	Datum	Name				

Tested by:
Darryl Scott / AFS Signatory

Checked by:
John Moore

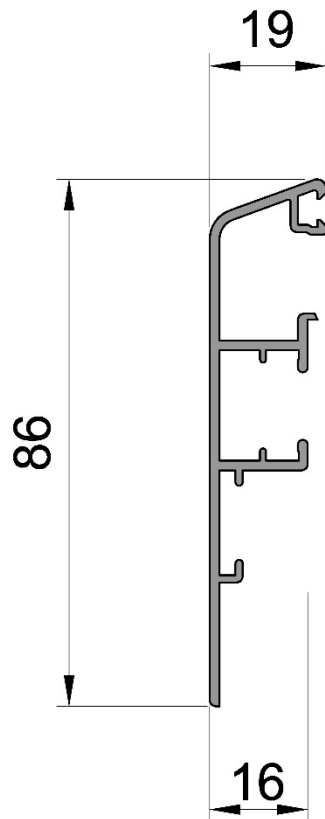


Technische Änderung vorbehalten!

				Oberfläche	Maßstab 1:1	Position	Menge
					-	-	
				Datum	Name	IDEALU68 cladding profile SS86-20	
			Bearb.	28.02.23			
			Gepr.				
			Norm				
			Weitergabe sowie Vervielfältigung dieses Dokuments, Verwertung und Mitteilung seines Inhalts sind verboten, soweit nicht ausdrücklich gestattet. Zuwiderhandlungen verpflichten zu Schadenersatz. Alle Rechte für den Fall der Patent-, Gebrauchsmuster- oder Geschmacksmuster-eintragung vorbehalten.				Blatt 12
Zust.	Änderungen	Datum	Name				

Tested by:
Darryl Scott / AFS Signatory

Checked by:
John Moore

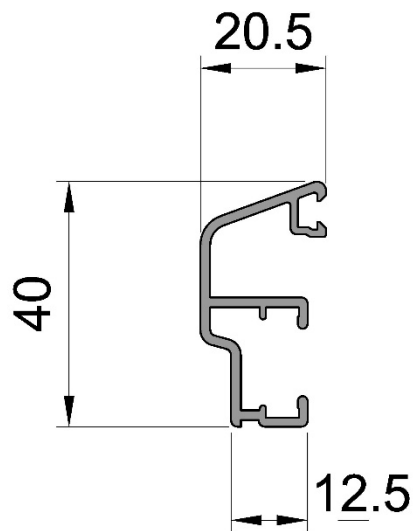


				Oberfläche		Maßstab	1:1	Position	Menge
						-		-	
				Datum	Name	IDEALU68 cladding profile FL40-20			
				Bearb.	28.02.23				
				Gepr.					
				Norm					
				<small> Weitergabe sowie Vervielfältigung dieses Dokuments, Verwertung und Mitteilung seines Inhalts sind verboten, soweit nicht ausdrücklich gestattet. Zuwiderhandlungen verpflichten zu Schadenersatz. Alle Rechte für den Fall der Patent-, Gebrauchsmuster- oder Geschmacksmustereintragung vorbehalten. </small>				Blatt	13
Zust.	Änderungen	Datum	Name						

Technische Änderung vorbehalten!

Tested by: 
Darryl Scott / AFS Signatory

Checked by: 
John Moore

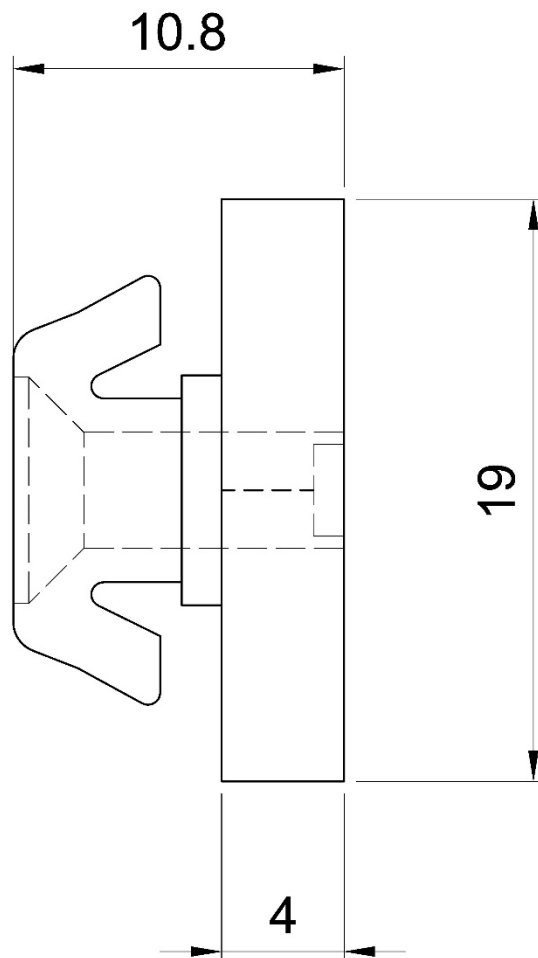


				Oberfläche		Maßstab 1:1	Position	Menge
						-	-	
				Datum		Name		
				Bearb. 28.02.23		IDEALU68		
				Gepr.		DC340		
				Norm				
				<small>Weitergabe sowie Vervielfältigung dieses Dokuments, Verwertung und Mitteilung seines Inhalts sind verboten, soweit nicht ausdrücklich gestattet. Zuwiderhandlungen verpflichten zu Schadenersatz. Alle Rechte für den Fall der Patent-, Gebrauchsmuster- oder Geschmacksmuster-eintragung vorbehalten.</small>				
				Blatt 14				
Zust.	Änderungen	Datum	Name					

Technische Änderung vorbehalten!

Tested by: 
Darryl Scott / AFS Signatory

Checked by: 
John Moore

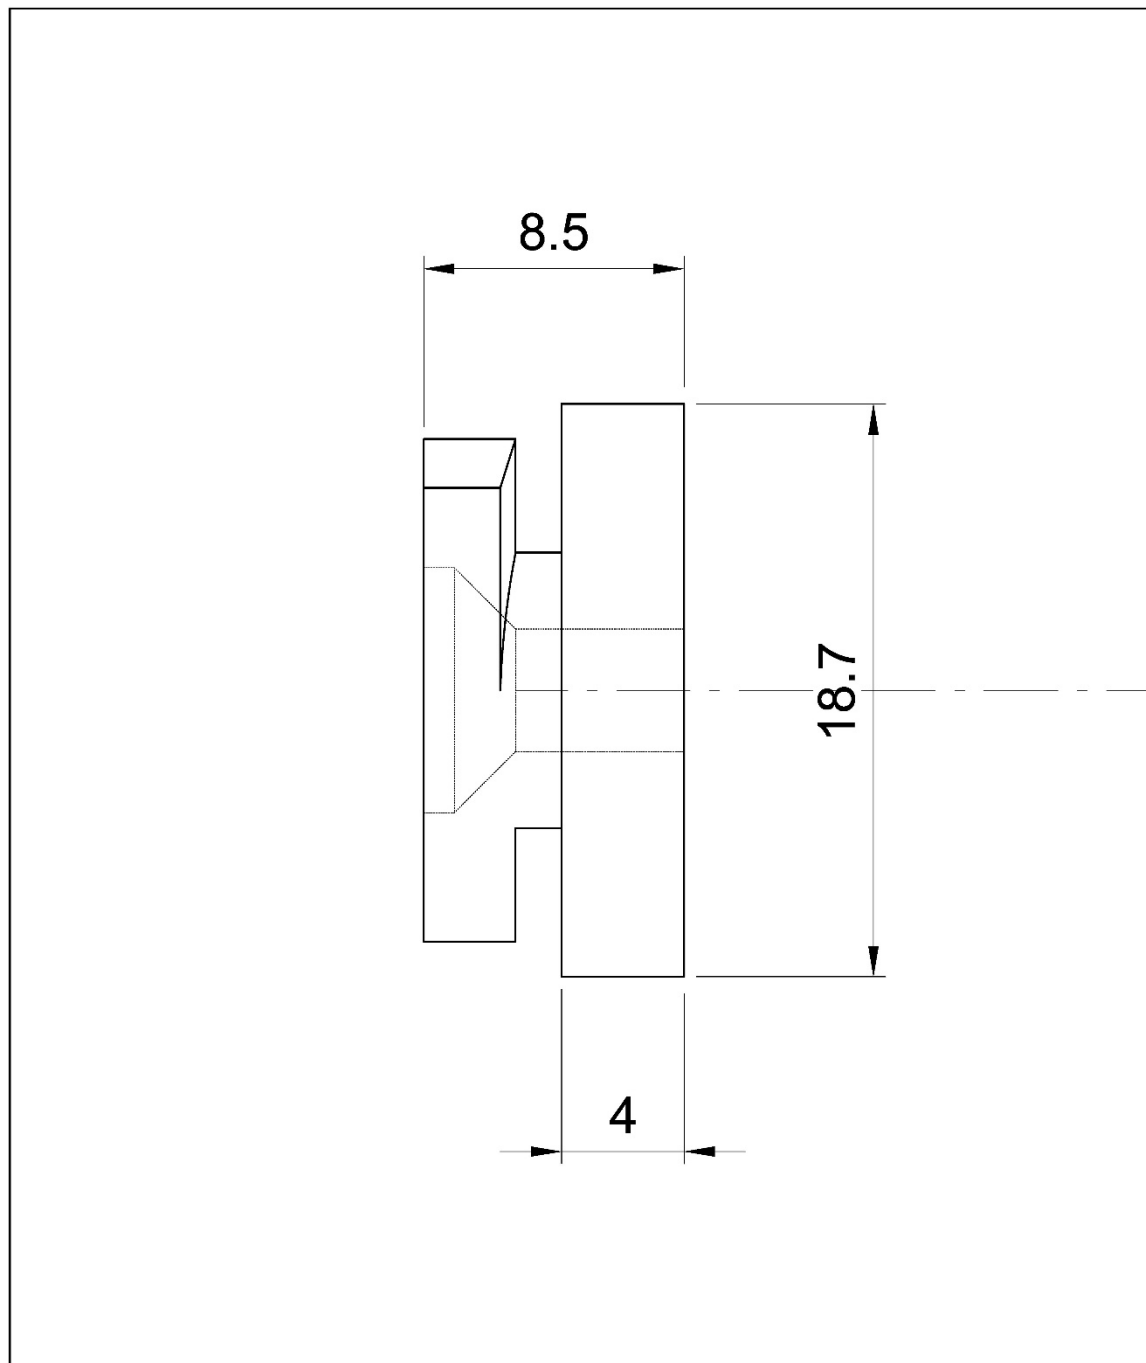

				Oberfläche	Maßstab 5:1	Position	Menge
					-	-	-
				Datum	Name	IDEALU68 MEH40	
				Bearb. 28.02.23			
				Gepr.			
				Norm			
				Weitergabe sowie Vervielfältigung dieses Dokuments, Verwertung und Mitteilung seines Inhalts sind verboten, soweit nicht ausdrücklich gestattet. Zuwiderhandlungen verpflichten zu Schadenersatz. Alle Rechte für den Fall der Patent-, Gebrauchsmuster- oder Geschmacksmustereintragung vorbehalten.			Blatt 15
Zust.	Änderungen	Datum	Name				

Tested by:
Darryl Scott / AFS Signatory

Checked by:
John Moore